


Central Patching Location

Fiber Trunk out to
Equipment Distribution
Area Zone Patching
Location



1. DCS 10U 11 Slot Director Patch Panel Enclosure
2. DCS 48 Channel Adapter Panel
3. 48 Channel-96 Fiber Trunk LC-LC
4. Director 48 Port Blade
5. Cisco 9513 Director Switch
6. LC-LC Patch Cable
7. DCS 6U 24 Channel LC Adapter Panel
8. DCS 6U 8 Slot Modular Patch Panel Enclosure

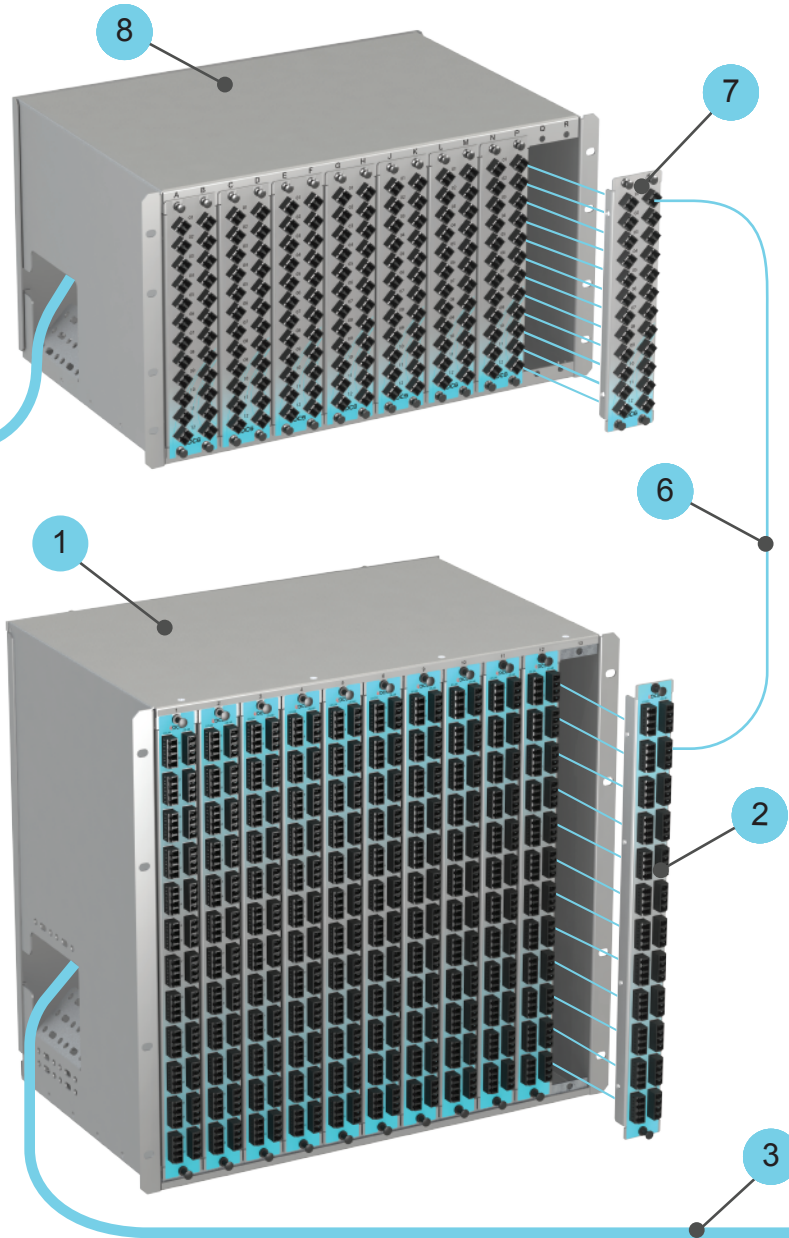